


City of Paramount  
Building Division  
16400 Colorado Ave.  
Paramount, Ca. 90723  
(562) 220-2036

## BLOCK WALL FENCE, 6'-0" HIGH MAXIMUM

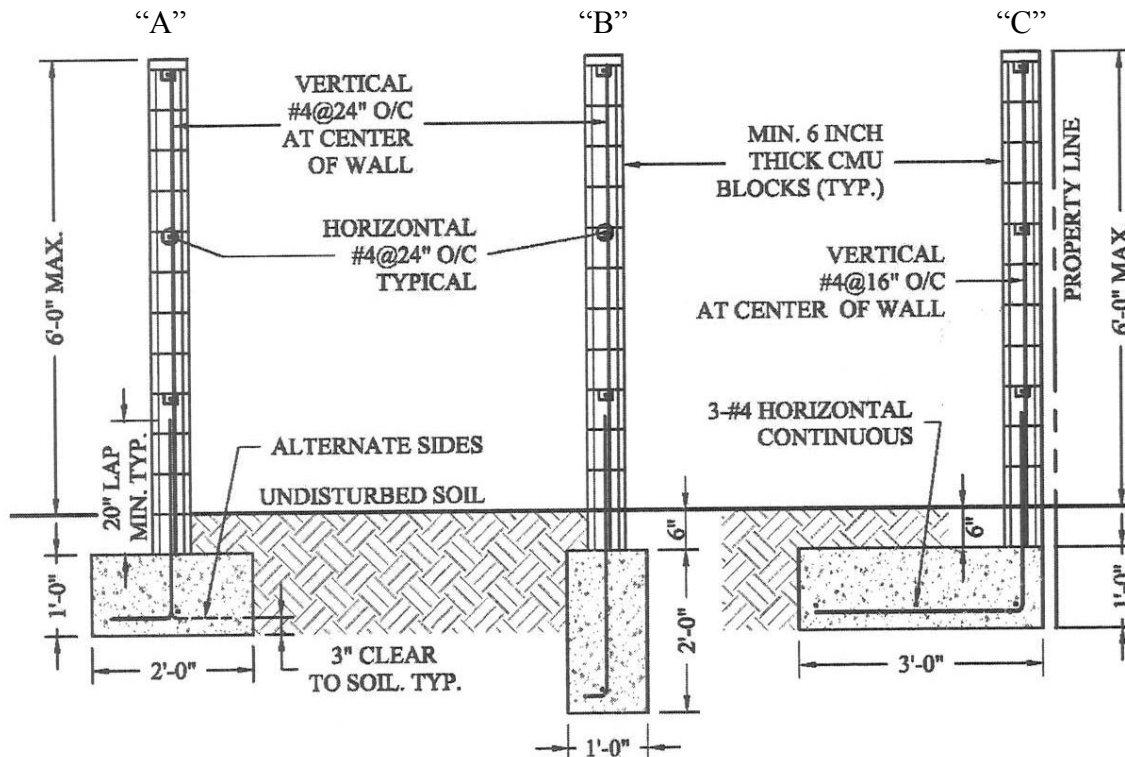

HEIGHT OF WALL	FOOTING		
	TYPE "A" WIDTH	TYPE "B" "DEPTH"	TYPE "C" "WIDTH"
3'-0"	12"MIN	12"MIN	16"MIN
4'-0"	16"MIN	16"MIN	20"MIN
5'-0"	20"MIN	20"MIN	24"MIN
6'-0"	24"MIN	24"MIN	36" MIN

### General Notes

- Concrete Masonry Unit (CMU) shall conform to CBC standard 24-6 and shall be staggered.
- Reinforcing steel shall be deformed, conform to ASTM standards, and be at least grade 40. Reinforcing shall be secured in place prior to grouting.
- All horizontal and vertical block cells and spaces containing reinforcing steel shall be fully grouted.
- Grout shall be consolidated by mechanical vibration.
- Foundation depth and width is measured into undisturbed natural soil.